



NOTE: MAXIMUM SPACING BETWEEN
DOOR CLAMPS ARE 15.00 INCHES.

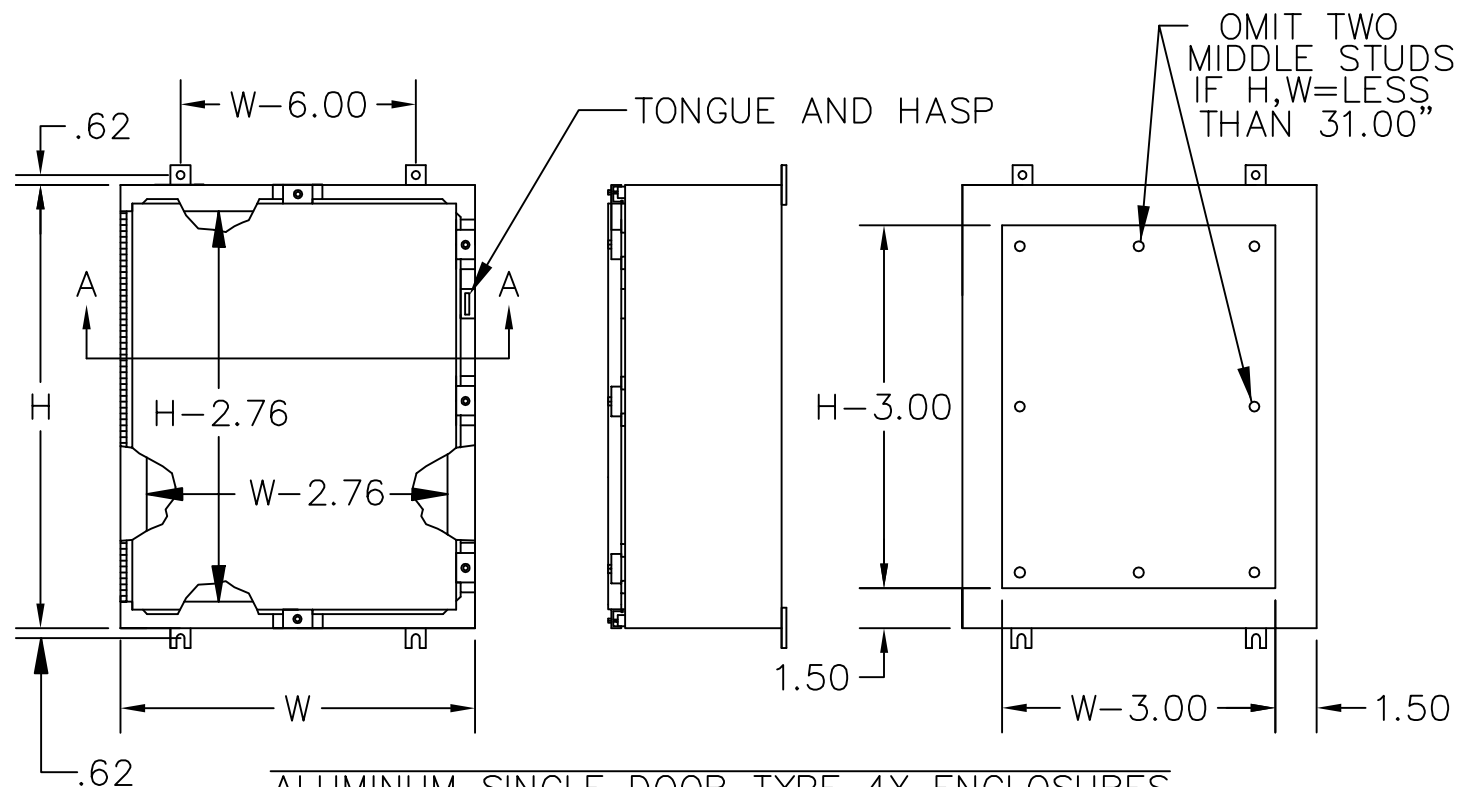

ALUMINUM SINGLE DOOR TYPE 4X ENCLOSURES

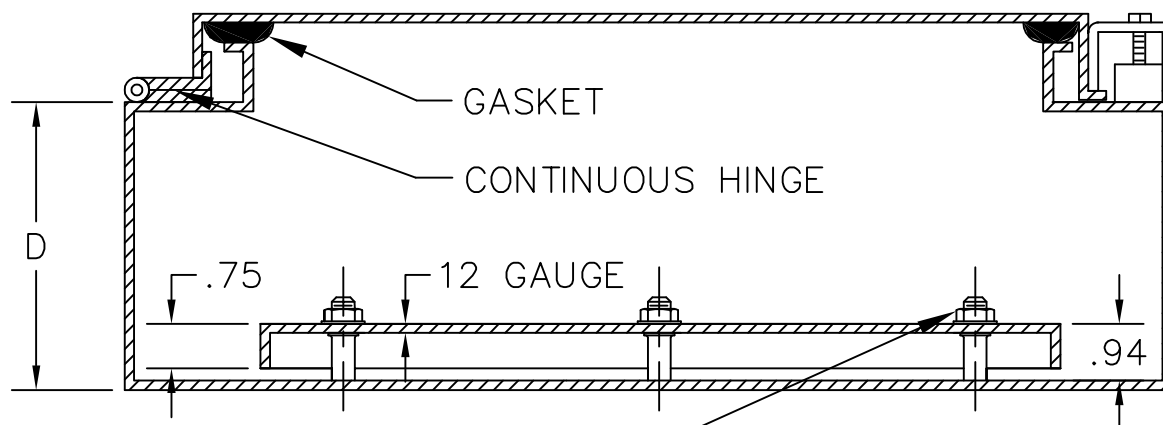

5-16 X 1.50
COLLAR STUD
SECTION A-A

CONSTRUCTION:

- TYPE 5052 H-32 .080 ALUMINUM.
- SEAMS CONTINUOUSLY WELDED AND GROUND SMOOTH.
- STAINLESS STEEL SCREWS AND CLAMPS ON THREE SIDES OF COVER ASSURE WATERTIGHT SEAL.
- STAINLESS STEEL CONTINUOUS HINGE.
- OIL-RESISTANT GASKET.
- TONGUE AND HASP FOR PADLOCKING.
- STUDS PROVIDED FOR MOUNTING OPTIONAL PANEL.

FINISH:

- ENCLOSURES ARE UNPAINTED AND HAVE AN E-BOX BRUSHED FINISH.

-H-	-W-	-D-

APPROVAL:



E-BOX
101 Air Park Industrial Road
Alabaster, Alabama 35007
Phone: (205)663-9189
Fax: (205)663-9587

